Tankless, Inc.
QUALITY, ENERGY-SAVING, TANKLESS HOT WATER HEATERS

2060 Whitfield Park Ave
Sarasota Fl 34243

1-800-TANKLESS or 800-826-5537
941 755 6529 FAX
EMAIL INFO@HOTWATERHEATER.COM

Intertek

This commercial heater is used large commercial applications and can be installed in parallel. Restaurants, food processing, offices, apartments, and housing are a few industries where they are in use. It is an excellent boiler replacement.

MODEL NAME

CE 108 KW

FEATURES	DATA
Phase of electricity required	Three
Full load AMP draw at available three phase Voltages n/a means not available	
Full load Amp draw at 575	n/a
Full load Amp draw at 480	129
Full load Amp draw at 240	258
Full load Amp Draw at 208	300
Y or Delta configuration for 480 volt units	Delta
In/out pipe size	1 1/4"
Heat Exchanger material	304 SS
Enclosure size W x H x D	36 x 36 x 12
Area needed to install and repair	60 x 53 x 48
Enclosure size including fittings	57 x 36 x 12
Enclosure rating	Nema 3, with Nema 4 or Nema 4 x available
Mounted at customer site via	Floor thru holes in C channel
Efficiency	98.90%
Operating pressure range	0-150 PSI
BTU output per hour	368,496
Temperature output maximum	185 F standard 90 F for Safety shower applications
Latent Heat Disposal System Available	Yes
Output temperature settings available	60 to 185 F
Output temperature adjustable	Yes,1 degree increments
Temperature output minimum	60
Freeze protection	Yes Standard
Number of overtemp protections	three
RS 232 interface available	Yes
Individually fused elements	Yes
Minimum flow to engage	2.0
Maximum flow at 60 PSI	62
Shipping weight	350
Shipping box size	skid only
Shipping mode	truck
Warranty	2 years electrical parts 5 years on heat exchanger

Nema 4 enclosure

Nema 3 enclosure

CUT SHEET

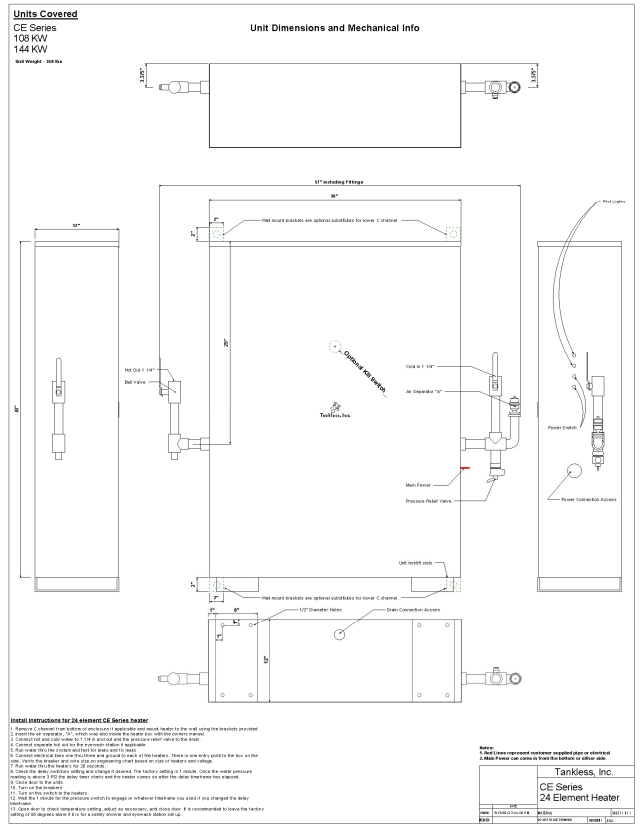

SUGGESTED SPECIFICATION

Tankless Water Heater shall be a Tankless Inc. model _____, with ____ KW, and _____vac to heat_____GPM@ a temperature rise of _____degrees F. Heating elements shall have an incoloy sheath. Heater shall have 3/4" or larger NPT fittings and have stainless steel heat exchangers and internal plumbing. Hot water storage tanks prohibited. Heating unit will be a Tankless, Inc. product or approved equal.