



2060 Whitfield Park Ave
 Sarasota FL 34243
 1-800-TANKLESS or 800-826-5537
 941 755 6529 FAX
 EMAIL INFO@HOTWATERHEATER.COM



At 123K BTU per hour it is good for smaller to medium applications. Excellent for office buildings and commercial applications. The heater supplies up to four sinks at one time or 5.5 gallons per minute at a 45 degree temperature rise.


MODEL NAME

CE 36 KW

FEATURES	DATA
Phase of electricity required	Three
Full load AMP draw at available three phase Voltages	
n/a means not available	
Full load Amp draw at 575	36
Full load Amp draw at 480	43
Full load Amp draw at 240	86
Full load Amp Draw at 208	100
Y or Delta configuration for 480 volt units	Delta
In/out pipe size	3/4"
Heat Exchanger material	304 SS
Enclosure size W x H x D	16 x 20.5 x 7.5
Area needed to install and repair	43 x 44.5 x 40
Enclosure size including fittings	22.5 x 32.5 x 7.5
Enclosure rating	NEMA 3, NEMA 4 available
Mounted at customer site via	Brackets at top and bottom of box
Efficiency	98.90%
Operating pressure range	0-150 PSI
BTU output per hour	of box
Temperature output maximum	185 F
Output temperature settings available	60 to 185 F
Output temperature adjustable	Yes, 1 degree increments
Temperature output minimum	60
Freeze protection	Yes Standard
Number of overtemp protections	three
RS 232 interface available	Yes
Individually fused elements	Yes
Minimum flow to engage in G.P.M.	2.0 with .5 available as a no added cost option
Maximum flow at 60 PSI	32
Shipping weight	58
Shipping box size	32 x 21 x 14
Shipping mode	UPS
Warranty	2 years electrical parts 5 years on heat exchanger



CUT SHEET

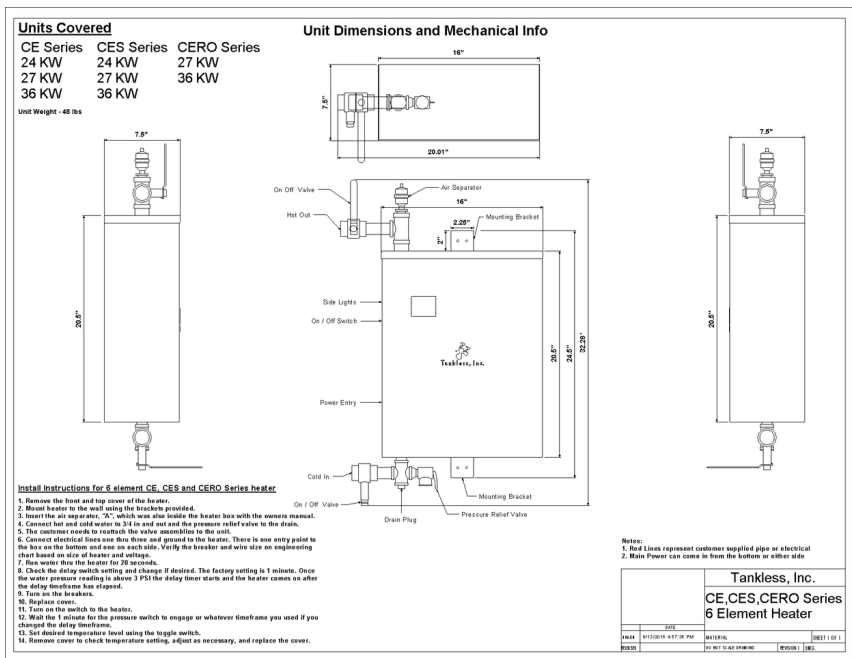

SUGGESTED SPECIFICATION

Tankless Water Heater shall be a Tankless Inc. model _____, with _____ KW, and _____ vac to heat _____ GPM@ a temperature rise of _____ degrees F. Heating elements shall have an incoloy sheath. Heater shall have 3/4" or larger NPT fittings and have stainless steel heat exchangers and internal plumbing. Hot water storage tanks prohibited. Heating unit will be a Tankless, Inc. product or approved equal.